



# NEWBERRY SPRINGS FIRE DEPT.

## MONTHLY REPORT SEPTEMBER- OCTOBER2024

**\*TRAINING IN HOUSE:** 14 Hours. Individual FireFighters Online Computer Training- (12) Hours.

- A. Medical / trauma bags and fire apparatus checked out weekly.
- B. Firefighter task books (for FF1 test) New FireFighters are in-rolling in NSFD "mini Academy"
- C. Introducing new FF's to our rigs & equipment. Donning structure gear & SCBA's.
- D. Wildland- in class learning 10's & 18's, wildland packs.
- E. Communications- Radio etiquette

**\*MUTUAL Fire Dept's Training: FSD-** Oct. 19<sup>th</sup> & 20<sup>th</sup> FIRE CONTROL III. "CANCELLED"

**\*CALL VOLUME & RESPONSE:**

(43) Calls in the month of SEPTEMBER

(5) Missed calls- (Mutual-Aid Received by MCLB & Desert Amb. in our absents)

(8) MUTUAL-AID GIVEN from Newberry Springs FD

(345) Calls To Date as of 10/16/24

**\*BP393-** 8/16/24 Took skid off of truck (waiting on pink slip/proof of title?)

**\*E392R-** Available for calls

**\*E392-** 8/5- installed new master pump drain assembly. Replaced (2) 3" pump panel gauges.

8/6- NFPA Annual pump test "PAST!!" 9/24-3" pressure gauge replaced for electric LDH valve.

9/27- poss. power steering leak-diagnosed with Fuel filter had pin hole leak, was replaced.

10/11- pump leak, found tank fill valve has pin hole leak in thread. Temp. patch work, Hoping to be replaced 10/17.

**\*BP392-** 9/24- Aux.pump motor starter repaired.

**\*WT392-** radio was fixed. A/C & heater out of service (will be fixed in-house after parts are purchased)

**\*STATION 392: "Bunking Quarters & Station 392-** as of 10/9-emailed our Edison planning specialist re: FD going to SB County Supervisor by the end of this working day if there's no progress on completion of Edison. On 10/10 panel inspection passed with SB County. Edison is now waiting to receive the inspection letter from SB County to move forward on transformer.

**\*EVENTS/ACTIVITIES/GRANTS:**



A. AFG-FY2021-FEMA funds were disbursed 3/8/24 to our bank as an ACH & not as a deposit. So when asking our bank on deposited check of \$138,486.05, did not show. Check to "AllStar Fire Equipment" was paid in full \$145,778.14.

**\*PUBLIC COMMENTS/REQUEST:**

Mr Stimfel would like to know if there is a way that the solar companies could have some kind of "Community Alert System" Inside the Lithium Battery containers, to alert the community members if the batteries were to catch fire. "I WAS UNABLE TO SET UP A MEETING WITH REPRESENTATIVES AT CLEARWAY"

**Major Incident Types by Month for Date Range**

Start Date: 09/01/2024 | End Date: 09/30/2024

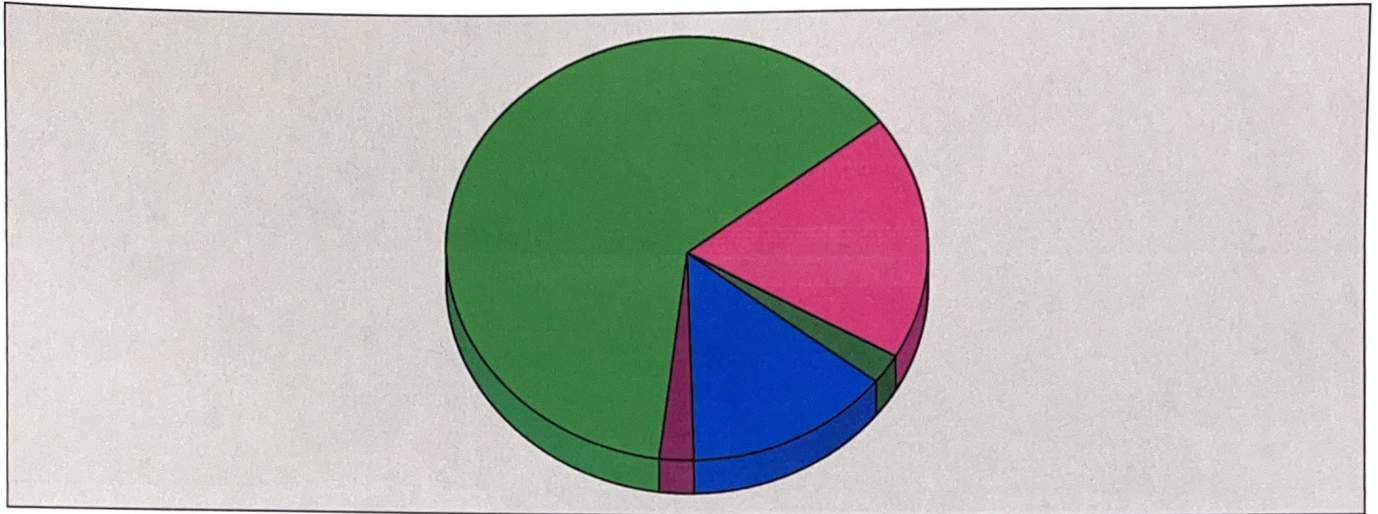

| INCIDENT TYPE                               | SEP       | TOTAL     |
|---|-----------|-----------|
| False Alarm & False Call                    | 1         | 1         |
| Fire  | 6         | 6         |
| Hazardous Condition (No Fire)               | 1         | 1         |
| Rescue & Emergency Medical Service Incident | 27        | 27        |
| Service Call                                | 8         | 8         |
| <b>Total</b>                                | <b>43</b> | <b>43</b> |

Only REVIEWED incidents included

